



ATLANTIC TESTING LABORATORIES

Albany
22 Corporate Drive
Clifton Park, NY 12065
518-383-9144 (T)
518-383-9166 (F)

TRANSMITTAL

September 13, 2013

Shelby Crushed Stone, Inc.
10830 Blair Road
Medina, New York 14103

Attn: Mr. Tom Biamonte

E/Mail: tom@shelbystone.com

Re: Laboratory Analysis
Aggregate Testing
NYSDOT Stockpile
77" ISC crusher running
ATL Project No. AT1069

Dear Mr. Biamonte:

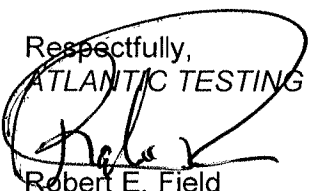
On August 23, 2013, your representative delivered one stone sample (ATL Sample No. AT1069S19) #2 Crushed Stone NYSDOT Stockpile, to our Clifton Park, New York, facility for testing. A 25-Cycle Resistance of Coarse Aggregates to Freezing and Thawing test, in accordance with NYSDOT 703-08 P,G, was performed. The laboratory test results follow:

25-Cycle Resistance of Coarse Aggregates to Freezing and Thawing
NYSDOT 703-08 P, G
Washed NYSDOT #2 Stone

ATL Sample No.	Sieve Fraction	Initial Weight (g)	Final Weight (g)	Fractional Loss (%)
AT1069S19	1" - 3/4"	1503.6	1401.3	6.8
	3/4" - 1/2"	1013.8	970.6	4.3
Totals:		2517.4	2371.9	-----
NYSDOT Specification: <20%		Total Loss: 5.8%		

Please contact our office should you have any questions or if we may be of further service.

Respectfully,
ATLANTIC TESTING LABORATORIES, Limited


Robert E. Field
Laboratory Manager
bfield@atlantictesting.com

REF/rf